

REFLECTIX® SUBMITTAL SHEET Duct Insulation R-6.0

Reflectix[®] Duct Insulation is an alternative to other types of fibrous insulation products. Ease of handling and quick installation make Reflectix[®] the first choice when selecting insulation for round or rectangular ductwork in HVAC systems. The product provides an R-6.0 when installed with a 0.75" air gap between the duct and the insulation. There is a choice of three spacer configurations that create the required air space.

PRODUCT DESCRIPTION

Reflectix[®] Duct Insulation consists of two layers of highly reflective film (96% reflectivity) that are bonded to two tough layers of polyethylene. Two inner layers of insulating bubbles resist conductive heat flow while a center layer of polyethylene gives Reflectix[®] high reliability and strength. The product has a tape running the length of the roll for easy identification by code officials. The tape identifies the manufacturer and ASTM Testing: Reflectix[®] Duct Insulation · ASTM E84 · Class A / Class 1 · ASTM C411 Passed

BENEFITS

•	Fiber-free Lowers heating / cooling costs year- round		Lightweight and clean Not affected by moisture / humidity Does not promote nesting of insects or rodents Resists growth of fungi, mold and mildew Does not require protective clothing or respirators to install
•			Does not require protective clothing or respirators to install
•	Costs less to install	•	ISO 9001:2015 Certified Manufacturing Location

REFLECTIX® DUCT INSULATION PART NUMBERS AND STOCK SIZES

• HVBP12050 (12"x 50')	• HVBP12100 (12"x 100')	• HVBP12125 (12"x 125')
• HVBP16050 (16"x 50')	• HVBP16100 (16"x 100')	• HVBP16125 (16"x 125')
• HVBP24050 (24"x 50')	• HVBP24100 (24"x 100')	• HVBP24125 (24"x 125')
• HVBP36050 (36"x 50')	HVBP36100 (36"x 100')	• HVBP36125 (36"x 125')
• HVBP48050 (48"x 50')	• HVBP48100 (48"x 100')	• HVBP48125 (48"x 125')
• HVBP60050 (60"x 50')	• HVBP60100 (60"x 100')	• HVBP60125 (60"x 125')

APPLICATIONS

Rectangular and Round return and supply ductwork in HVAC systems

ASHRAE ASHRAE HARDI HARDI HARDI HOUS HOUS

Features AT A GLANCE:

Reflectix[®] Duct Insulation may be installed by wrapping rectangular or round ductwork in HVAC applications

Heating costs can be greatly reduced


Eliminate unnecessary heat loss/gain and air leakage

Helps to ensure consistent temperatures

WAREHOUSE LOCATIONS:

Markleville, IN · Phoenix, AZ Greenville, SC · Needham, MA

Reflectix, Inc. A Division of Balcan Innovations Inc. #1 School St. (PO Box 108) Markleville, IN 46056 (800) 879-3645 Fax: (765) 533-2327 www.reflectixinc.com

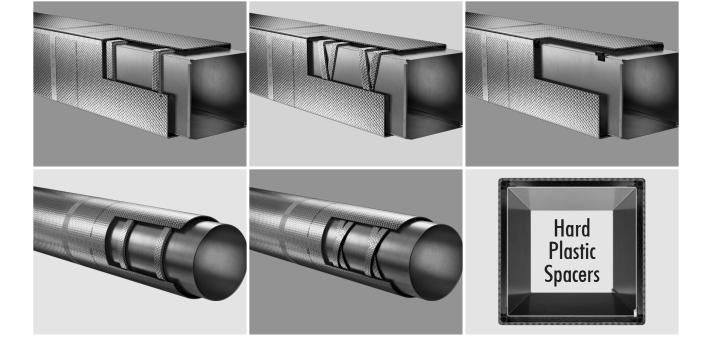

DOUBLE REFLECTIVE TECHNICAL DATA

Temperature Range:	-30° to $+180^{\circ}$ F			
Nominal Thickness:	5/16 inch (.312)			
Weight:	0.771 oz./sq. ft.			
Flame Spread Index (ASTM E 84):	Less than 25			
Smoke Developed Index (ASTM E 84):	Less than 50			
Mounting Method (ASTM E 2599)				
Fire Rating:	Class A/Class 1			
Linear Shrinkage:	None			
Reflectance (IR):	96%			
Water Vapor Transmission (ASTM E 96): 0.02				
Puncture Resistance:	60 lb./in.			
Mold and Mildew:	No Growth			
Emittance:	0.04			
Tensile Strength:	3.7 N/mm			
Pliability:	No Cracking			
Hot Surface Performance:	Passed (250° F)			
Note: Not for use in direct contact on				

surface temperatures that are 180° F or greater.

TESTING & CERTIFICATIONS

- Thermal Performance ASTM C335
- Hot Surface Performance ASTM C411
- Flame Spread and Smoke Density ASTM E84
- Fungus Resistance Mil-Std 810B Method 508
- Pliability Test ASTM C1224
- Sound Absorption Test ASTM C423 and ASTM E795
- Sound Transmission Loss ASTM E90 and ASTM E413
- Water Vapor Transmission ASTM E96
- · Tensile Strength ASTM D751
- · Bleeding and Delamination ASTM C1668
- Intertek: Surface Burning Characteristics of Building Materials ASTM E84-08 (Taped Joint Detail) Test Report # 3166908SAT-012
- Intertek: Surface Burning Characteristics of Building Materials ASTM E84-08 (Unslit) Test Report # 3166908SAT-011
- R&D Services: Resistance to the Growth of Fungi ASTM C1338-00 Test Report # RD072713FR
- · State of California
- · State of California Licensed Insulation Manufacturer
- State of Minnesota: Filed with Minnesota Insulation Standards Program
- · R&D Services Emittance Testing ASTM C1371
- R&D Services: Physical Properties Sheet Width, Length, Pliability, Water Vapor Permanence and Aged Water Vapor Permanence
- R&D Services: Water Vapor Transmission Test ASTM-E96 (Dessicant Method)

MANUFACTURER'S SUGGESTED INSTALLATION INSTRUCTIONS

THERE ARE 3 OPTIONS - METHODS 1 & 2 ARE APPLICABLE TO EITHER ROUND OR RECTANGULAR DUCTS:

NOTE: Installation instructions and illustrated drawings are recommendations only,

while proper local construction methods are the responsibility of the installer.

1. SPACER PERPENDICULAR TO DUCT DIRECTION METHOD

SPACER: HVSPW02025 - REFLECTIX® SPIRAL PIPE WRAP 2"x 25'

- Refer to the two left hand diagrams on page 2.
- \cdot Make sure all sheet metal joints, seams and penetrations are sealed.
- Double wrap and secure spacer material to the duct at 24" to 36" intervals. Use a UL181 Tape with Acrylic Adhesive to fasten the spacer in place.
- · Verify the circumference of the duct at the mid-point of a spacer strip.
- $\cdot~$ Cut the Reflectix $^{\scriptscriptstyle (\! 8\!)}$ product to this length plus 1".
- Wrap the product around the duct and securely tape the linear and circumference seams (overlapping 1"- 2") with a UL181 Tape with Acrylic Adhesive (goal is an air-tight, snug seam seal).
- Do not leave any exposed duct or space where air can enter between the duct and the Reflectix®.

2. SPACER WRAPPED IN CANDY CANE FASHION METHOD

SPACER: HVSPW02025 - REFLECTIX® SPIRAL PIPE WRAP 2"x 25'

- · Refer to the two center diagrams on page 2.
- · Make sure all sheet metal joints, seams and penetrations are sealed.
- Double wrap and secure spacer material to the duct in a candy cane fashion. First, proceed down the duct in one direction then reverse direction and crisscross (overlap) the spacer in the other direction. Use a UL181 Tape with Acrylic Adhesive to fasten the spacer in place.
- \cdot Verify the circumference of the duct with the spacer strips in place.
- · Cut the Reflectix® product to this length plus 1".
- Wrap the product around the duct and securely tape the linear and circumference seams (overlapping 1"- 2") with a UL181 Tape with Acrylic Adhesive (goal is an air-tight, snug seam seal).
- · Do not leave any exposed duct or space where air can enter between the duct and the Reflectix®.
- 3. HV SPACERS AFFIXED TO CORNERS METHOD (RECTANGULAR DUCTS ONLY)

<u>SPACER</u>: HVSPACER - REFLECTIX[®] HARD PLASTIC CORNER SPACER

- · Refer to the two right hand diagrams on page 2.
- $\cdot\,$ Make sure all sheet metal joints, seams and penetrations are sealed.
- \cdot Make sure the duct is free from dust and dirt by wiping it down with a shop rag.
- · Install the HV Spacers to all 4 corners of the duct.
- Place the spacers every 24".
- · Verify the circumference of the duct over the top of the spacers.
- · Cut the Reflectix[®] product to this length plus 1".
- Wrap the Reflectix® over the spacers.
- Fasten the Reflectix[®] by either taping the seam with a UL181 Tape with Acrylic Adhesive, or plier stapling the two edges together (goal is an airtight, snug seam seal).
- If the duct is supported with saddle clamps, make sure to install a spacer on the two bottom edges of the duct directly between the clamp and the duct.
- · If the clamps are installed around the duct (such as plumbers tape), make sure that the seam is taped to prevent air movement.

PLEASE NOTE REGARDING HANGERS:

Strap Hanger: Wrap Reflectix[®] with the seam at the hanger. Tape seam tightly around hanger.

Saddle Hanger: Make sure that there is a spacer below the hanger between the insulation and the duct to prevent the insulation from touching the duct.

NOTE: Not to be used as duct liner.